


# Cryopep

Cryogenics at the service of haemostasis

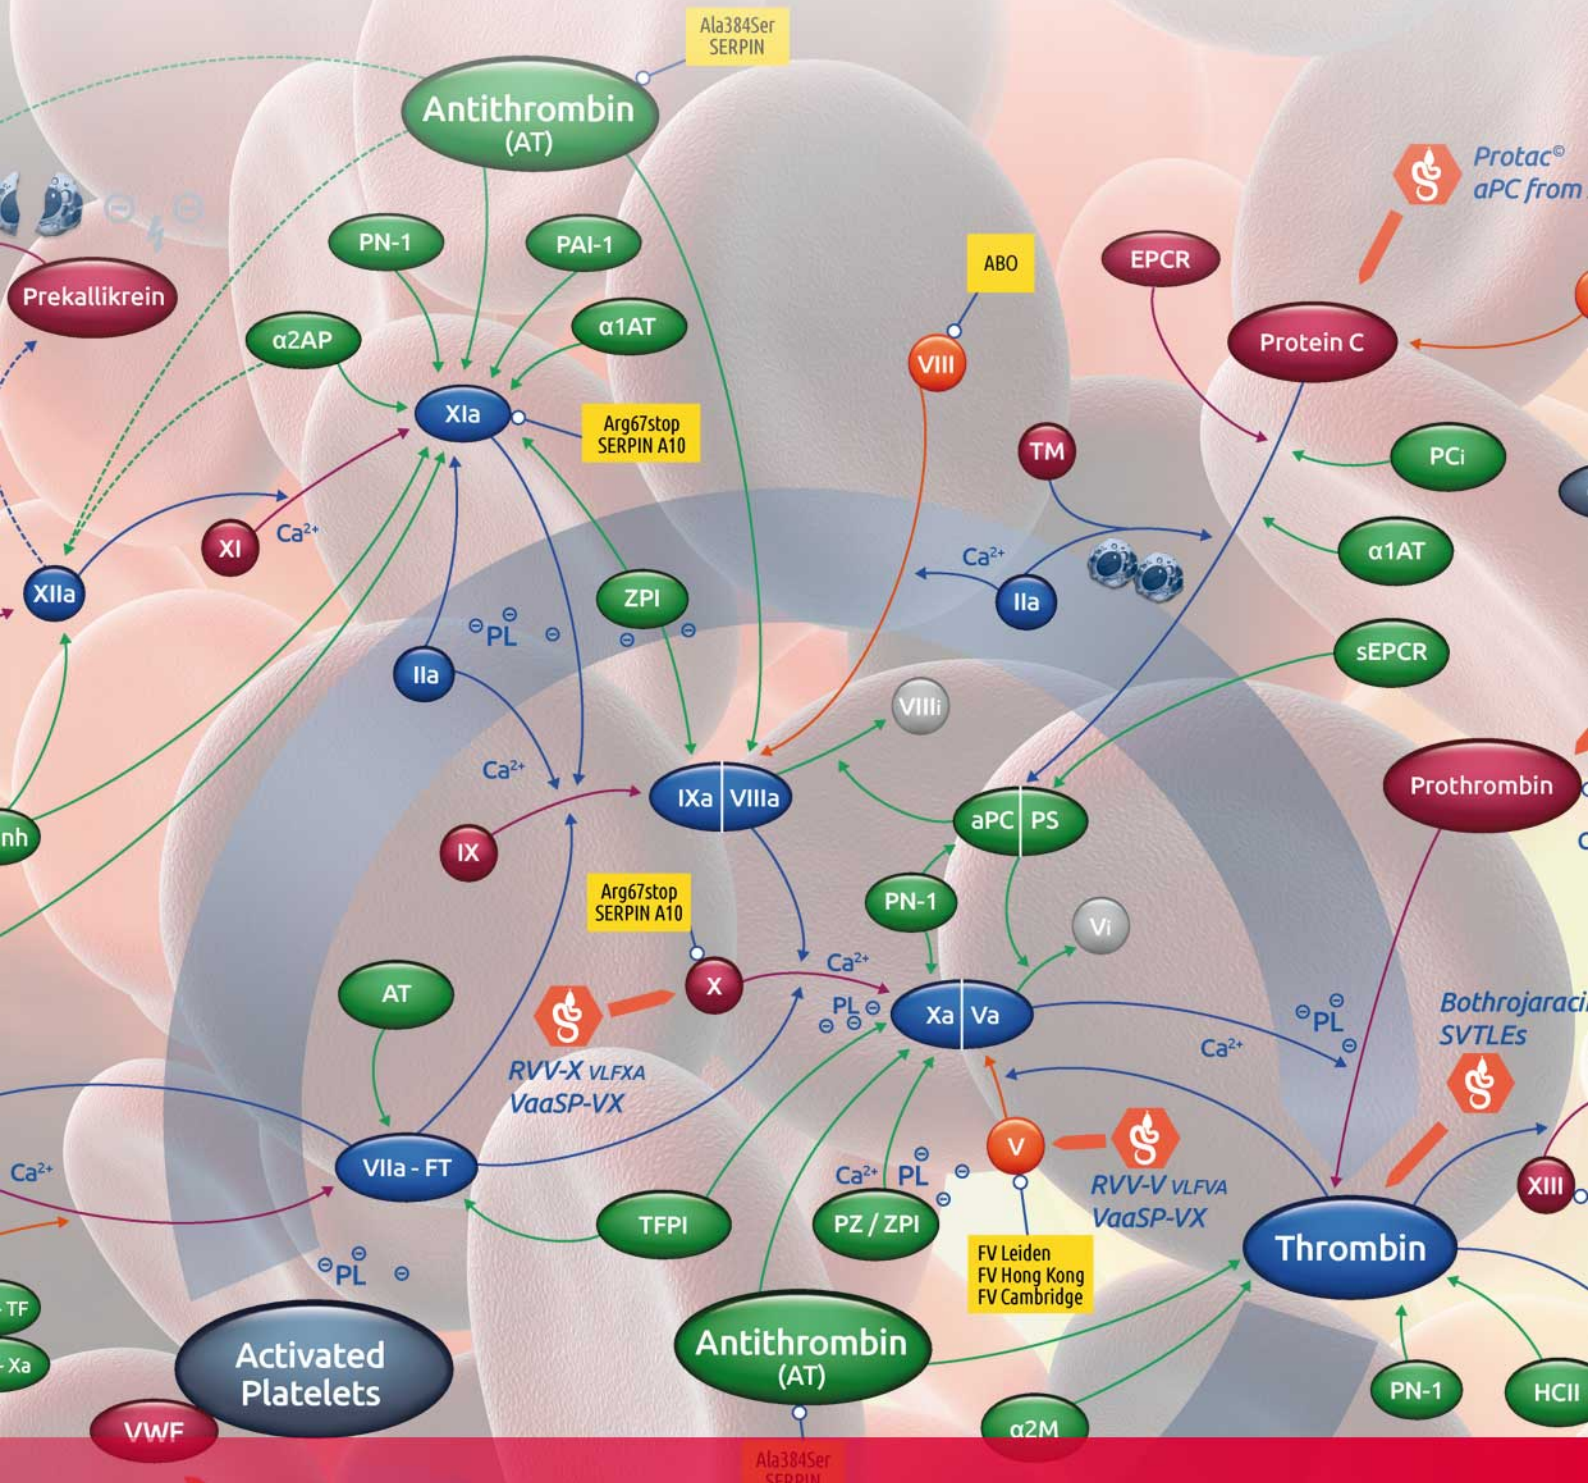

## DEFICIENT PLASMAS

Edition of 2024-04-11 15:04:44

Botrocetin  
Bitiscetin  
Kaouthiagin

Endothelial Cells

Bilinuxin  
Convulxin  
Echicetin  
EMS16

Mucetin  
Rhodocytin  
Sochicetin-A  
Triwaglerin

way

# DEFICIENT PLASMAS

## Immunodepleted deficient plasmas

### a2-Antiplasmin Immunodepleted Deficient Human

Plasma

| Ref          | Format      |
|--------------|-------------|
| 6-FDPA2AP    | 1 x 100 mL  |
| 6-FDPA2AP-10 | 10 x 1.0 mL |



### Antithrombin Immunodepleted Deficient Human

Plasma

| Ref        | Format      |
|------------|-------------|
| 6-FDPAT    | 1 x 100 mL  |
| 6-FDPAT-10 | 10 x 1.0 mL |



### Antithrombin/Heparin Cofactor II Immunodepleted

Deficient Human Plasma

| Ref             | Format      |
|-----------------|-------------|
| 6-FDPATHCFII    | 1 x 100 mL  |
| 6-FDPATHCFII-10 | 10 x 1.0 mL |



### Fibrinogen Immunodepleted Deficient Human

Plasma

| Ref         | Format      |
|-------------|-------------|
| 6-FDPFIB    | 1 x 100 mL  |
| 6-FDPFIB-10 | 10 x 1.0 mL |



### FII Immunodepleted Deficient Human Plasma

| Ref         | Format      |
|-------------|-------------|
| 6-FDPFII    | 1 x 100 mL  |
| 6-FDPFII-10 | 10 x 1.0 mL |



### FIX Immunodepleted Deficient Human Plasma

| Ref         | Format      |
|-------------|-------------|
| 6-FDPFIX    | 1 x 100 mL  |
| 6-FDPFIX-10 | 10 x 1.0 mL |



### FV Immunodepleted Deficient Human Plasma

| Ref        | Format      |
|------------|-------------|
| 6-FDPFV    | 1 x 100 mL  |
| 6-FDPFV-10 | 10 x 1.0 mL |



### FVII Immunodepleted Deficient Human Plasma

| Ref          | Format      |
|--------------|-------------|
| 6-FDPFVII    | 1 x 100 mL  |
| 6-FDPFVII-10 | 10 x 1.0 mL |



### FVIII Immunodepleted Deficient Human Plasma

| Ref           | Format      |
|---------------|-------------|
| 6-FDPFVIII    | 1 x 100 mL  |
| 6-FDPFVIII-10 | 10 x 1.0 mL |



### FVIII Immunodepleted Deficient Human Plasma with VWF

| Ref                | Format     |
|--------------------|------------|
| 6-FDPFVIII-VWF     | 1 x 100 mL |
| 6-FDPFVIII-VWF-50  | 1 x 50 mL  |
| 6-FDPFVIII-VWF-500 | 1 x 500 mL |



### FX Immunodepleted Deficient Human Plasma

| Ref        | Format      |
|------------|-------------|
| 6-FDPFX    | 1 x 100 mL  |
| 6-FDPFX-10 | 10 x 1.0 mL |



### FXI Immunodepleted Deficient Human Plasma

| Ref         | Format      |
|-------------|-------------|
| 6-FDPFXI    | 1 x 100 mL  |
| 6-FDPFXI-10 | 10 x 1.0 mL |



### FXII Immunodepleted Deficient Human Plasma

| Ref          | Format      |
|--------------|-------------|
| 6-FDPFXII    | 1 x 100 mL  |
| 6-FDPFXII-10 | 10 x 1.0 mL |



### FXIII Immunodepleted Deficient Human Plasma

| Ref           | Format      |
|---------------|-------------|
| 6-FDPFXIII    | 1 x 100 mL  |
| 6-FDPFXIII-10 | 10 x 1.0 mL |



### Heparin Cofactor II Immunodepleted Deficient Human Plasma

| Ref          | Format      |
|--------------|-------------|
| 6-FDPHCII    | 1 x 100 mL  |
| 6-FDPHCII-10 | 10 x 1.0 mL |



### Kinogen Immunodepleted Deficient Human

Plasma

| Ref         | Format      |
|-------------|-------------|
| 6-FDPKIN    | 1 x 100 mL  |
| 6-FDPKIN-10 | 10 x 1.0 mL |



### PAI-1 Immunodepleted Deficient Human Plasma

| Ref         | Format      |
|-------------|-------------|
| 6-FDPPAI    | 1 x 100 mL  |
| 6-FDPPAI-10 | 10 x 1.0 mL |



### B2GP1 Immunodepleted Deficient Human Plasma



| Ref           | Format      |
|---------------|-------------|
| 6-FDPB2GP1    | 1 x 100 mL  |
| 6-FDPB2GP1-10 | 10 x 1.0 mL |



# DEFICIENT PLASMAS



**Prekallikrein Immunodepleted Deficient Human Plasma**

| Ref        | Format      |
|------------|-------------|
| 6-FDPPK    | 1 x 100 mL  |
| 6-FDPPK-10 | 10 x 1.0 mL |



**Plasma Factor VIII deficient chemically depleted**

| Ref        | Format     |
|------------|------------|
| 9-FVIII-CD | from 50 mL |



**Plasminogen Immunodepleted Deficient Human Plasma**

| Ref         | Format      |
|-------------|-------------|
| 6-FDPPLG    | 1 x 100 mL  |
| 6-FDPPLG-10 | 10 x 1.0 mL |



**Protein C Immunodepleted Deficient Human Plasma**

| Ref        | Format      |
|------------|-------------|
| 6-FDPPC    | 1 x 100 mL  |
| 6-FDPPC-10 | 10 x 1.0 mL |



**Protein C Inhibitor Immunodepleted Deficient Human Plasma**

| Ref         | Format      |
|-------------|-------------|
| 6-FDPPCI    | 1 x 100 mL  |
| 6-FDPPCI-10 | 10 x 1.0 mL |



**Protein S Immunodepleted Deficient Human Plasma**

| Ref        | Format      |
|------------|-------------|
| 6-FDPPS    | 1 x 100 mL  |
| 6-FDPPS-10 | 10 x 1.0 mL |



**t-PA Immunodepleted Deficient Human Plasma**

| Ref         | Format      |
|-------------|-------------|
| 6-FDPTPA    | 1 x 100 mL  |
| 6-FDPTPA-10 | 10 x 1.0 mL |



**t-PA/PAI-1 Immunodepleted Deficient Human Plasma**

| Ref            | Format      |
|----------------|-------------|
| 6-FDPTPAPAI    | 1 x 100 mL  |
| 6-FDPTPAPAI-10 | 10 x 1.0 mL |



**TAFI Immunodepleted Deficient Human Plasma**

| Ref          | Format      |
|--------------|-------------|
| 6-FDPTAFI    | 1 x 100 mL  |
| 6-FDPTAFI-10 | 10 x 1.0 mL |

**VWF Immunodepleted Deficient Human Plasma**



| Ref        | Format      |
|------------|-------------|
| 6-FDPVW    | 1 x 100 mL  |
| 6-FDPVW-10 | 10 x 1.0 mL |

## Congenital deficient plasmas (Bottles)



**Human FVIII congenital deficient plasma with Anti-VIII inhibitor (Bethesda)**

| Ref          | Format        |
|--------------|---------------|
| 6-PPD08C-INH | Minimum 50 mL |



**Human Factor II congenital deficient plasma >5%**

| Ref      | Format        |
|----------|---------------|
| 6-PPD02C | Minimum 50 mL |



**Human Factor V congenital deficient plasma (severe <1%)**

| Ref        | Format        |
|------------|---------------|
| 6-PPD05C-S | Minimum 50 mL |



**Human Factor V congenital deficient plasma >5%**

| Ref      | Format        |
|----------|---------------|
| 6-PPD05C | Minimum 50 mL |



**Human Factor VII congenital deficient plasma (severe <1%)**

| Ref        | Format        |
|------------|---------------|
| 6-PPD07C-S | Minimum 50 mL |

**Human Factor VII congenital deficient plasma >5%**

| Ref      | Format        |
|----------|---------------|
| 6-PPD07C | Minimum 50 mL |





# DEFICIENT PLASMAS

| Human Factor VIII congenital deficient plasma (severe <1%) |               |  |
|--|---------------|--|
| Ref  | Format        |  |
| 6-PPD08C-S   | Minimum 50 mL |  |




| Human Factor VIII congenital deficient plasma >5% |               |  |
|---|---------------|--|
| Ref   | Format        |  |
| 6-PPD08C  | Minimum 50 mL |  |




| Human Factor IX congenital deficient plasma >5% |               |  |
|---|---------------|--|
| Ref   | Format        |  |
| 6-PPD09C  | Minimum 50 mL |  |




| Human Factor IX congenital deficient plasma (severe <1%) |               |  |
|--|---------------|--|
| Ref  | Format        |  |
| 6-PPD09C-S   | Minimum 50 mL |  |




| Human Factor X congenital deficient plasma >5% |               |  |
|--|---------------|--|
| Ref  | Format        |  |
| 6-PPD10C                                       | Minimum 50 mL |  |




| Human Factor X congenital deficient plasma (severe <1%) |               |  |
|---|---------------|--|
| Ref   | Format        |  |
| 6-PPD10C-S  | Minimum 50 mL |  |




| Human Factor XI congenital deficient plasma >5% |               |  |
|---|---------------|--|
| Ref   | Format        |  |
| 6-PPD11C  | Minimum 50 mL |  |




| Human Factor XI congenital deficient plasma (severe <1%) |               |  |
|--|---------------|--|
| Ref  | Format        |  |
| 6-PPD11C-S   | Minimum 50 mL |  |




| Human Antithrombin congenital deficient plasma |               |  |
|--|---------------|--|
| Ref  | Format        |  |
| 6-PPDATC                                       | Minimum 50 mL |  |




| Human Plasminogen congenital deficient plasma |               |  |
|---|---------------|--|
| Ref   | Format        |  |
| 6-PPDPLGC                                     | Minimum 50 mL |  |




| Human Protein C congenital deficient plasma |               |  |
|---|---------------|--|
| Ref   | Format        |  |
| 6-PPDPCC                                    | Minimum 50 mL |  |




| Protein S human deficient plasma (congenital) |               |  |
|---|---------------|--|
| Ref   | Format        |  |
| 6-PPDPSC                                      | Minimum 50 mL |  |




| Alpha-2-antiplasmin human deficient plasma (congenital) |               |  |
|---|---------------|--|
| Ref   | Format        |  |
| 6-PPDA2APC  | Minimum 50 mL |  |



| High molecular weight kininogen human deficient plasma (congenital) |               |  |
|---|---------------|--|
| Ref   | Format        |  |
| 6-PPDKINC   | Minimum 50 mL |  |




| Human Factor XII congenital deficient plasma >5% |               |  |
|--|---------------|--|
| Ref  | Format        |  |
| 6-PPD12C   | Minimum 50 mL |  |




| Human Factor XII congenital deficient plasma (severe <1%) |               |  |
|---|---------------|--|
| Ref   | Format        |  |
| 6-PPD12C-S  | Minimum 50 mL |  |



| Human Factor XIII congenital deficient plasma >5% |               |  |
|---|---------------|--|
| Ref   | Format        |  |
| 6-PPD13C  | Minimum 50 mL |  |



| Human Factor XIII congenital deficient plasma (severe <1%) |               |  |
|--|---------------|--|
| Ref  | Format        |  |
| 6-PPD13C-S   | Minimum 50 mL |  |



# DEFICIENT PLASMAS

## Acquired deficient plasmas (Bottles)

### Antithrombin human deficient plasma (acquired)

| Ref      | Format        |
|----------|---------------|
| 6-PPDATA | Minimum 50 mL |



### Plasminogen human deficient plasma (acquired)

| Ref       | Format        |
|-----------|---------------|
| 6-PPDPLGA | Minimum 50 mL |



### Prekallikrein human deficient plasma (acquired)

| Ref      | Format        |
|----------|---------------|
| 6-PPDPKA | Minimum 50 mL |



### Protein C human deficient plasma (acquired)

| Ref      | Format        |
|----------|---------------|
| 6-PPDPCA | Minimum 50 mL |




### Protein S human deficient plasma (acquired)

| Ref      | Format        |
|----------|---------------|
| 6-PPDPSA | Minimum 50 mL |



### Human plasma deficient in alpha-2-antiplasmin (acquired)

| Ref        | Format        |
|------------|---------------|
| 6-PPDA2APA | Minimum 50 mL |



### High molecular weight kininogen human deficient plasma (acquired)

| Ref       | Format        |
|-----------|---------------|
| 6-PPDKINA | Minimum 50 mL |



## Congenital deficient plasmas (Kits)

### Human Factor V congenital Deficient Plasma

| Ref    | Format     |
|--------|------------|
| 7-0500 | 5 x 1.0 mL |



### Human Factor VII congenital Deficient Plasma

| Ref    | Format     |
|--------|------------|
| 7-0700 | 5 x 1.0 mL |



### Human Factor VIII congenital Deficient Plasma

| Ref    | Format     |
|--------|------------|
| 7-0800 | 5 x 1.0 mL |



### Human Factor VIII congenital Deficient Plasma with inhibitor

| Ref    | Format     |
|--------|------------|
| 7-1800 | 5 x 1.0 mL |



### Human Factor IX congenital Deficient Plasma

| Ref    | Format     |
|--------|------------|
| 7-0900 | 5 x 1.0 mL |



### Human Factor X congenital Deficient Plasma

| Ref    | Format     |
|--------|------------|
| 7-1000 | 5 x 1.0 mL |



### Human Factor XI congenital Deficient Plasma

| Ref    | Format     |
|--------|------------|
| 7-1100 | 5 x 1.0 mL |



### Human Factor XII congenital Deficient Plasma

| Ref    | Format     |
|--------|------------|
| 7-1200 | 5 x 1.0 mL |



### Human Factor XIII congenital Deficient Plasma

| Ref      | Format     |
|----------|------------|
| 7-1300-0 | 5 x 1.0 mL |
| 7-1300-1 | 5 x 0.5 mL |



# DEFICIENT PLASMAS

## Human Prekallikrein congenital Deficient Plasma


| Ref    | Format     |
|--------|------------|
| 7-1700 | 5 x 1.0 mL |



## Deficient Human Plasma in Native VWF (VWD Type 1)

1)


| Ref    | Format     |
|--------|------------|
| 7-1401 | 5 x 1.0 mL |

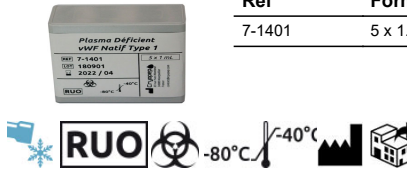

## Deficient Human Plasma in Native VWF (VWD Type 2A)

2A)


| Ref    | Format     |
|--------|------------|
| 7-1404 | 5 x 1.0 mL |

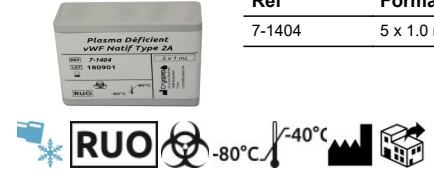

## Deficient Human Plasma in Native VWF (VWD Type 2B)

2B)


| Ref    | Format     |
|--------|------------|
| 7-1402 | 5 x 1.0 mL |

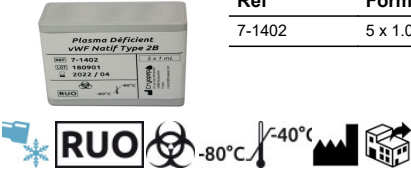

## Deficient Human Plasma in Native VWF (VWD Type 3)

3)

| Ref    | Format     |
|--------|------------|
| 7-1403 | 5 x 1.0 mL |

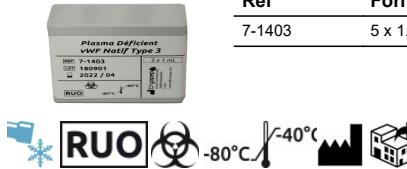

## EXPLANATION FOR SYMBOLS USED



These kits are manufactured in accordance with the 98/79 EC directive for in vitro diagnostic devices. Only CE marked products can be used for diagnostic applications in Europe.



These kits are intended for in vitro diagnostic use.



These kits are for research use only and are not intended to be used for diagnostic procedures.

**FDA**

Federal Drug Administration, FDA validates diagnostic kits for in vitro diagnostic use in the United States.



Biological risk products



Storage between 2 and 8 ° C



Reactive in liquid form



Reactive in lyophilized form



Reactive in frozen form



Stability after opening at 2-8 ° C



Products that can be refrozen



Stability 12 months after refreezing at -20 ° C



Manufacturer



Importer



Distributor

# Your order

1

## To order, several possibilities

|              |  |
|--------------|--|
| By telephone | +33(0)4 67 10 71 20                                      |
| By fax       | +33(0)4 67 10 71 21                                      |
| By e-mail    | contact@cryopep.com                                      |
| By letter    | CRYOPEP, 83 rue Yves Montand, 34 080 Montpellier, FRANCE |

2

## Command Processing

We carefully pack frozen products in boxes with dry ice or cold packs according of the nature of the product.

To optimize the conditions of transport of our products, we ship our packages in dry ice only from Monday to Wednesday, except urgent customer requests.

All other orders for freeze-dried products are shipped from Monday to Friday.

3

## Transport

We work exclusively with carriers receiving ISO 9001 and CERTIPHARM certifications.

We guarantee timely delivery of all products.

During transportation, we follow all our shipments and, if necessary, call our customers to check that the packages have been received in the laboratory.

Visit our website : <https://www.cryopep.com>